


- Note:
- (1). Modulating Board
Input Signal: 4~20mA, 1~5V, 2~10V.
(it is suggested to use the shielding wire and its length should not exceed 30m).
Output Signal: 4~20mA, 2~10V.
 - (2). Using less than 3A current for "A,B,C,D,E,F".

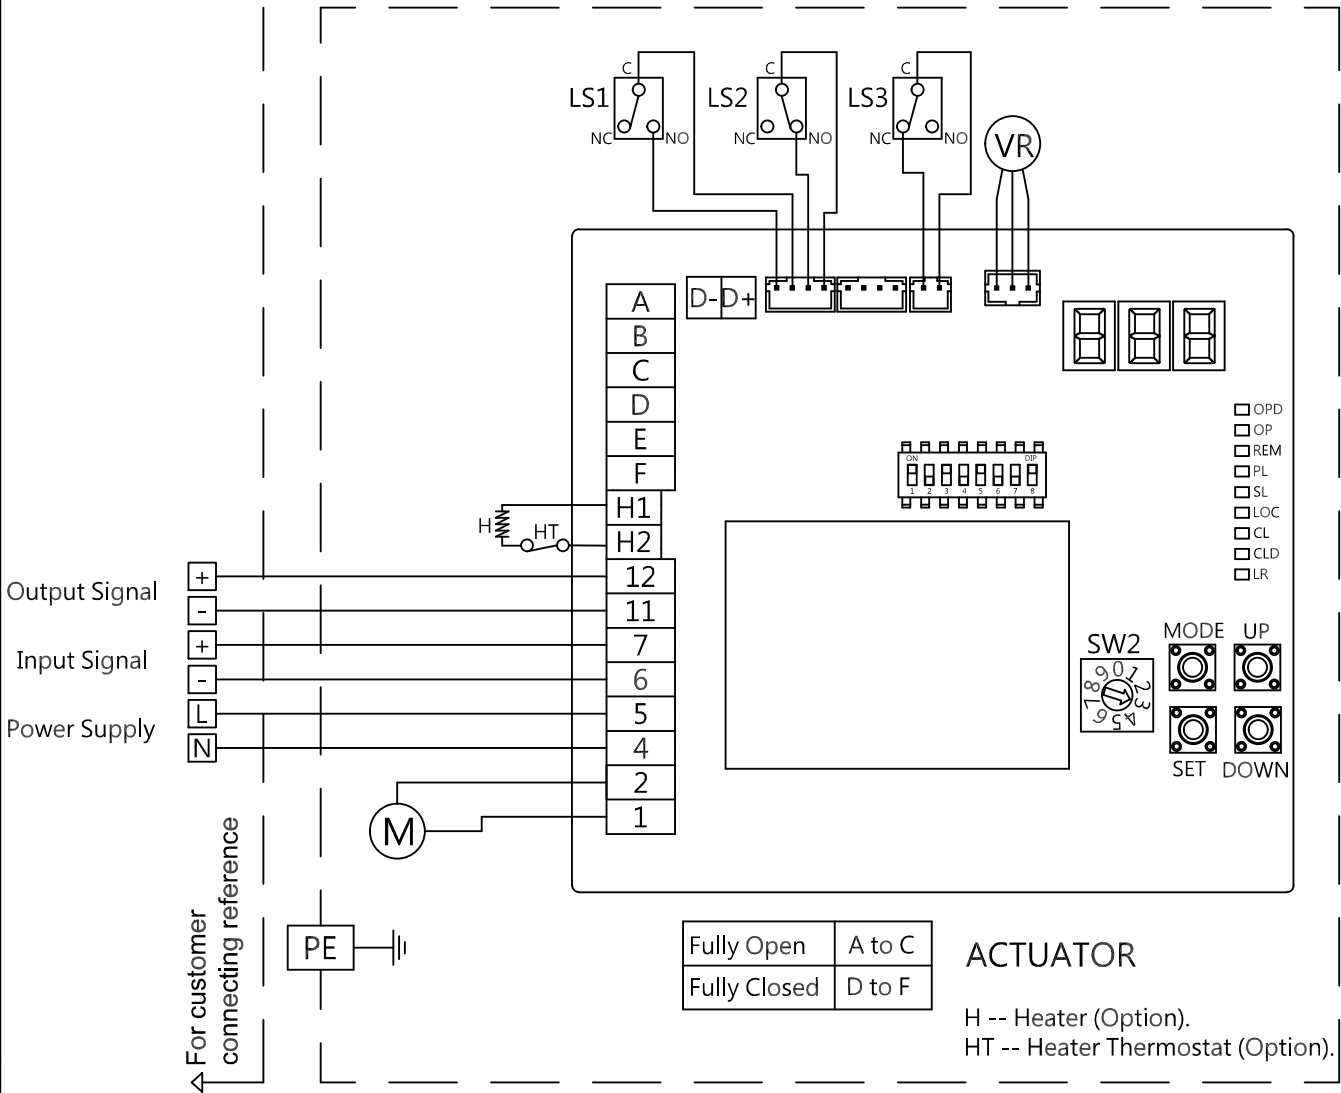

Wiring Diagram NO: 03-005-17-02-03-3-001

Rev	1.0	Signature	Date	L250 - L500
Designed				Power Supply : 110~120VAC 1-Phase
Drawn	Wen Yao	2018/08/02		Modulating Control
Checked	Ming Hung	2018/08/18		75% Duty Cycle
Approved				