


Note:

- (1). "N" connects to 4, "L" connects to 5.
- (2). "8" connects to 6 for "OPEN", "8" connects to 7 for "CLOSE".
- (3). Using less than 3A current for "A,B,C,D,E,F".

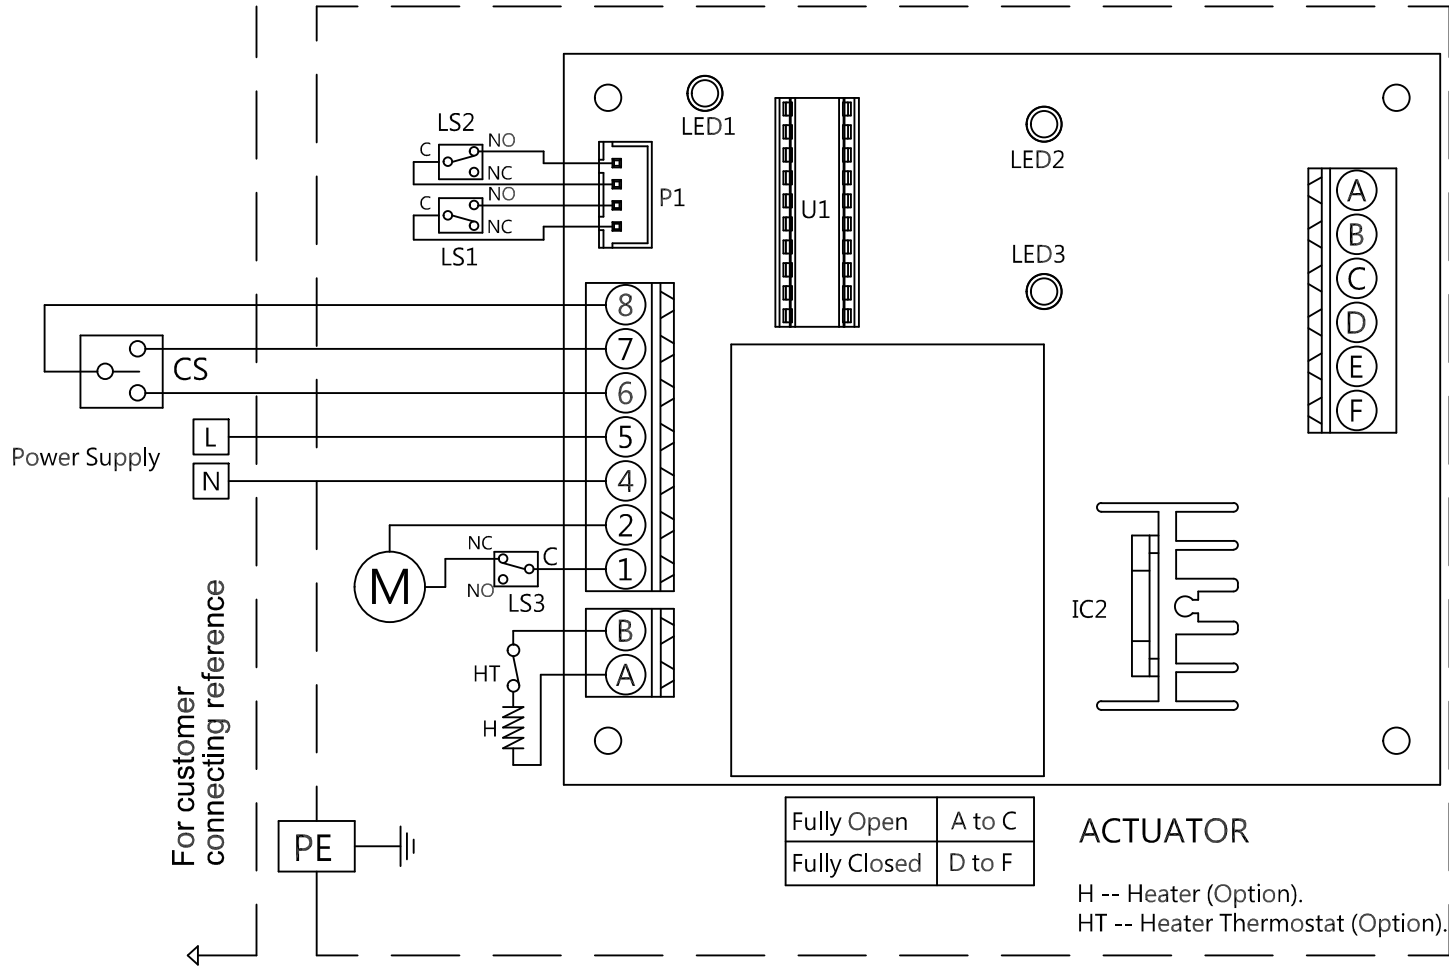

For customer connecting reference

Fully Open	A to C
Fully Closed	D to F

ACTUATOR

H -- Heater (Option).
HT -- Heater Thermostat (Option).

Wiring Diagram NO: 08-005-18-02-02-03-3-001

Rev	1.0	Signature	Date	LE250 · LE500 Power Supply : 220~240VAC 1-Phase Floating Control 75% Duty Cycle
Designed				
Drawn	Wen Yao	2018/08/02		
Checked	Ming Hung	2018/08/15		
Approved				