


Note:

- (1). Modulating Board  
 Input Signal : 4~20mA, 1~5V, 2~10V.  
 (it is suggested to use the shielding wire and its length should not exceed 30m)  
 Output Signal : 4~20mA, 2~10V.
- (2). Using less than 5A current for "A,B,C,D,E,F".

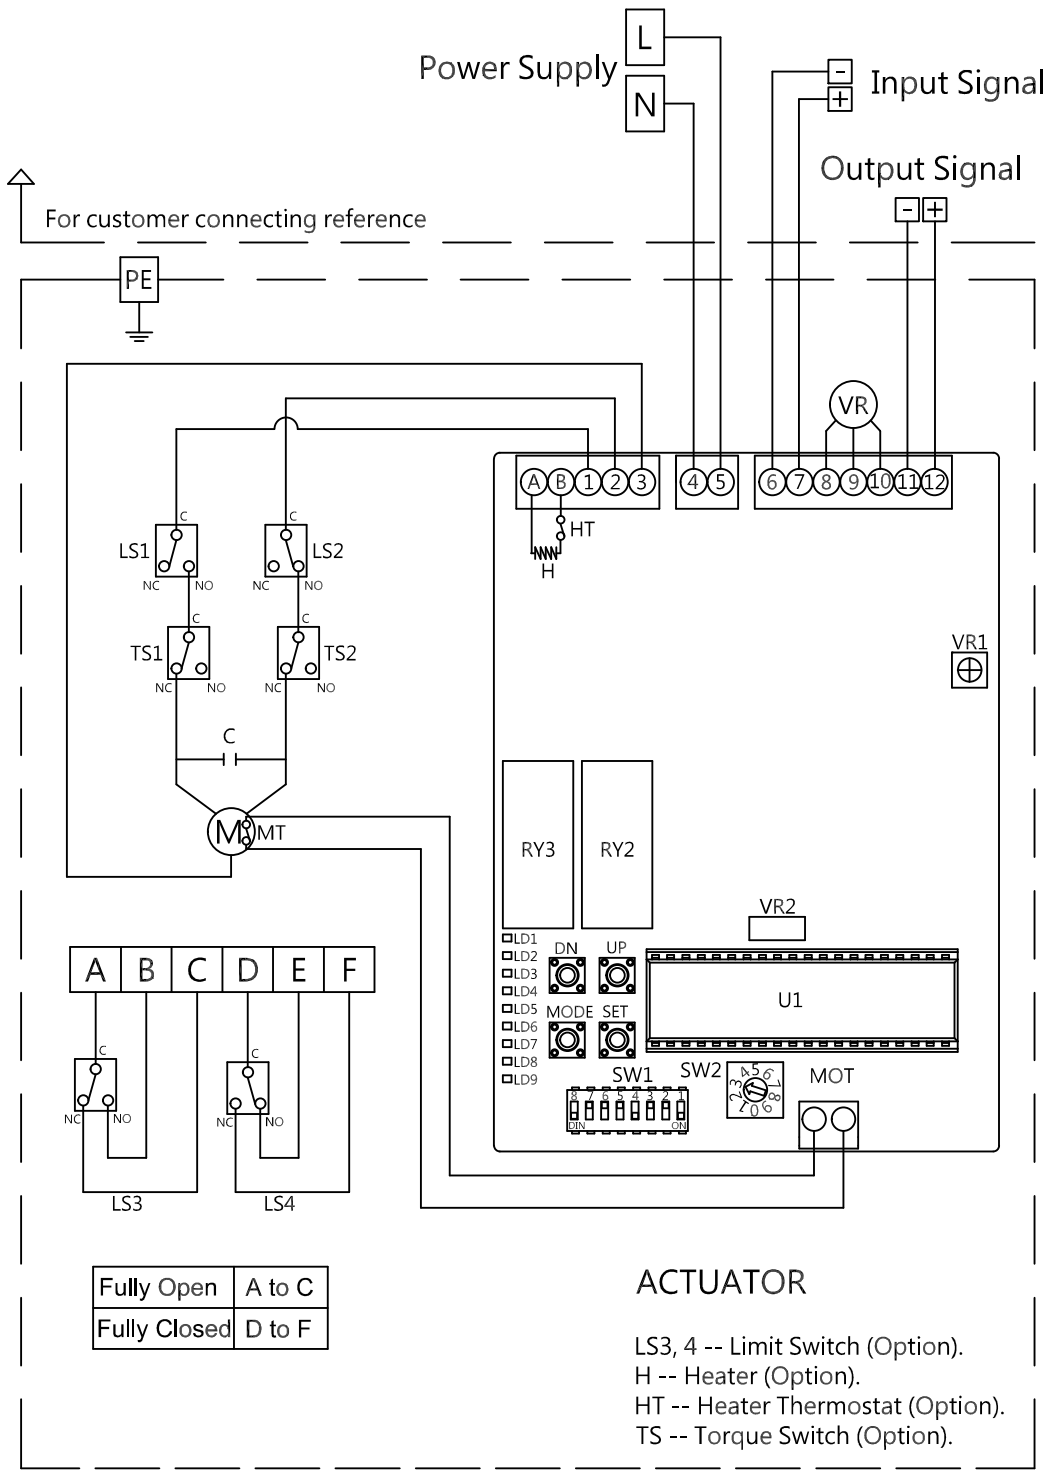

Fully Open	A to C
Fully Closed	D to F

**ACTUATOR**

- LS3, 4 -- Limit Switch (Option).
- H -- Heater (Option).
- HT -- Heater Thermostat (Option).
- TS -- Torque Switch (Option).

Wiring Diagram NO: 01-026-17-02-03-01-3-001

Rev	1.0	Signature	Date	OM2~OM8 · OMF · OMG · OMH Power Supply : 110~120VAC 1-Phase Modulating Control 30% Duty Cycle
Designed				
Drawn	MING YU	2018/08/09		
Checked	Ming Hung	2018/09/01		
Approved				